


BACKFILL IN PAVED AREAS SHALL BE
CRUSHED STONE. SEE SPECIFICATIONS.

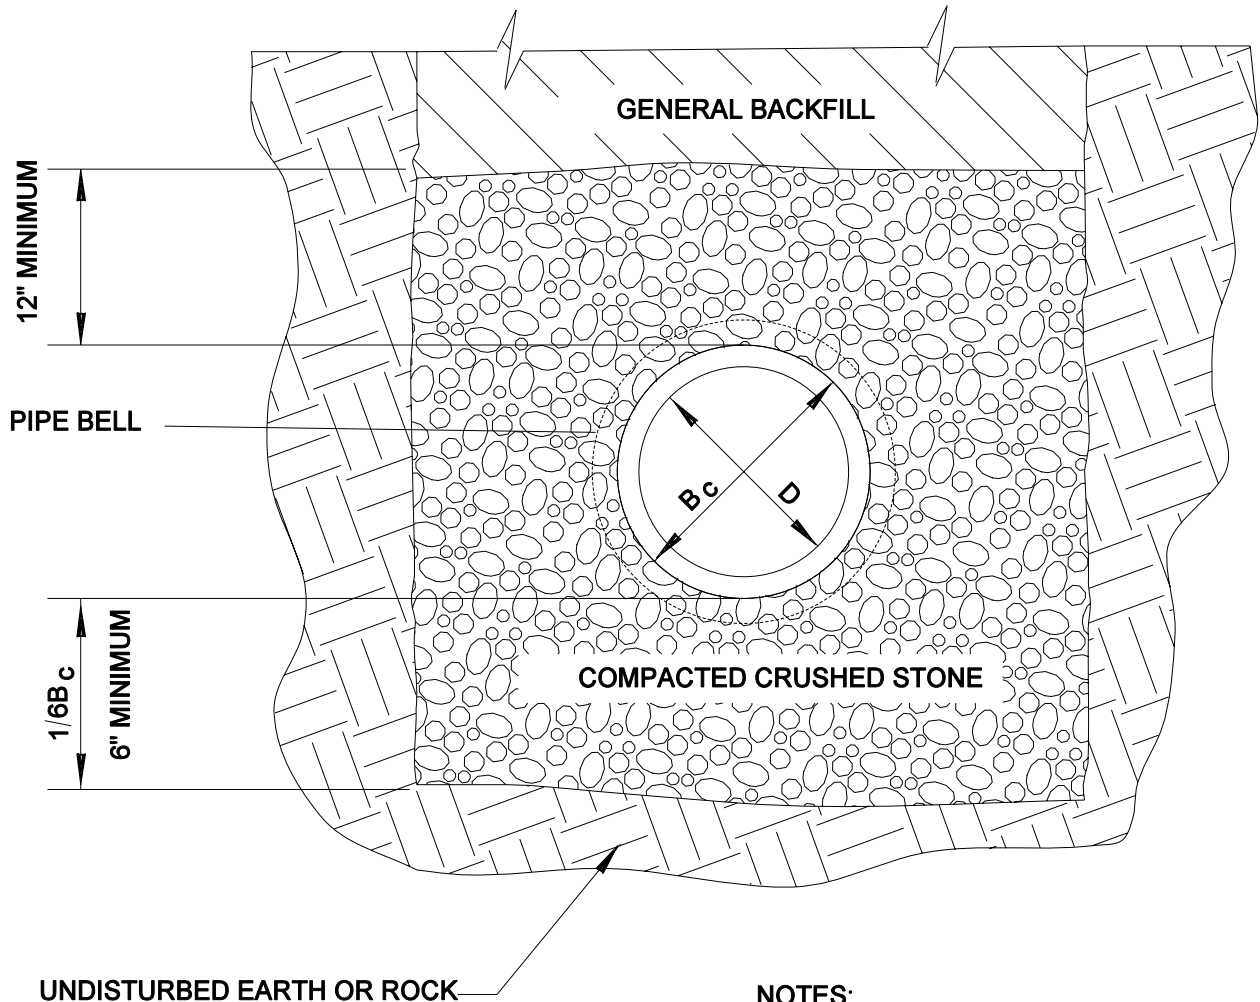

ALL PVC GRAVITY SEWER
PIPE SHALL BE INSTALLED
ON CLASS "B" BEDDING
UNLESS OTHERWISE
INDICATED OR AUTHORIZED.

NOTES:

- 1) DETAILS ARE APPLICABLE TO BOTH EARTH & ROCK TRENCHES.
- 2) COMPACTED CRUSHED STONE SHALL BE SIZE NO. 67 AS GIVEN IN SECTION 903 OF THE T.D.O.T. STANDARD SPECIFICATIONS FOR ROAD & BRIDGE CONSTRUCTION.
- 3) SEE STANDARD DRAWINGS S-20A & S-20C FOR ADDITIONAL BEDDING DETAILS.

CLASS "B" BEDDING

DRAWING NOT TO SCALE

MAY 27, 1994

DRAWN BY: M.H. & A.H.W.F.
APPROVED BY: K.N.H.

BEDDING DETAILS

DRAWING 2 OF 3

STANDARD
DRAWING NO.

S - 20B

MURFREESBORO WATER & SEWER DEPARTMENT

DATE REVISED: